

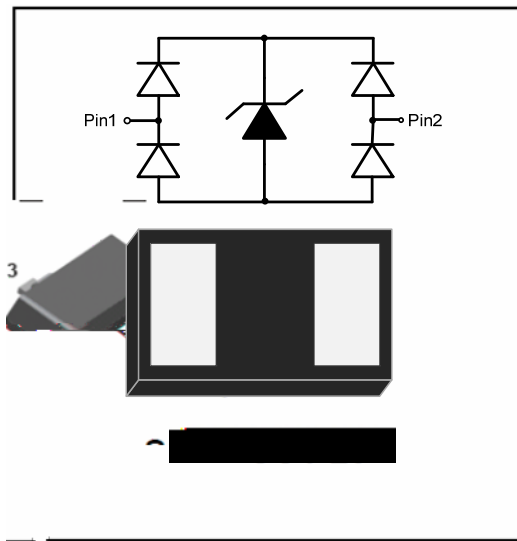


V

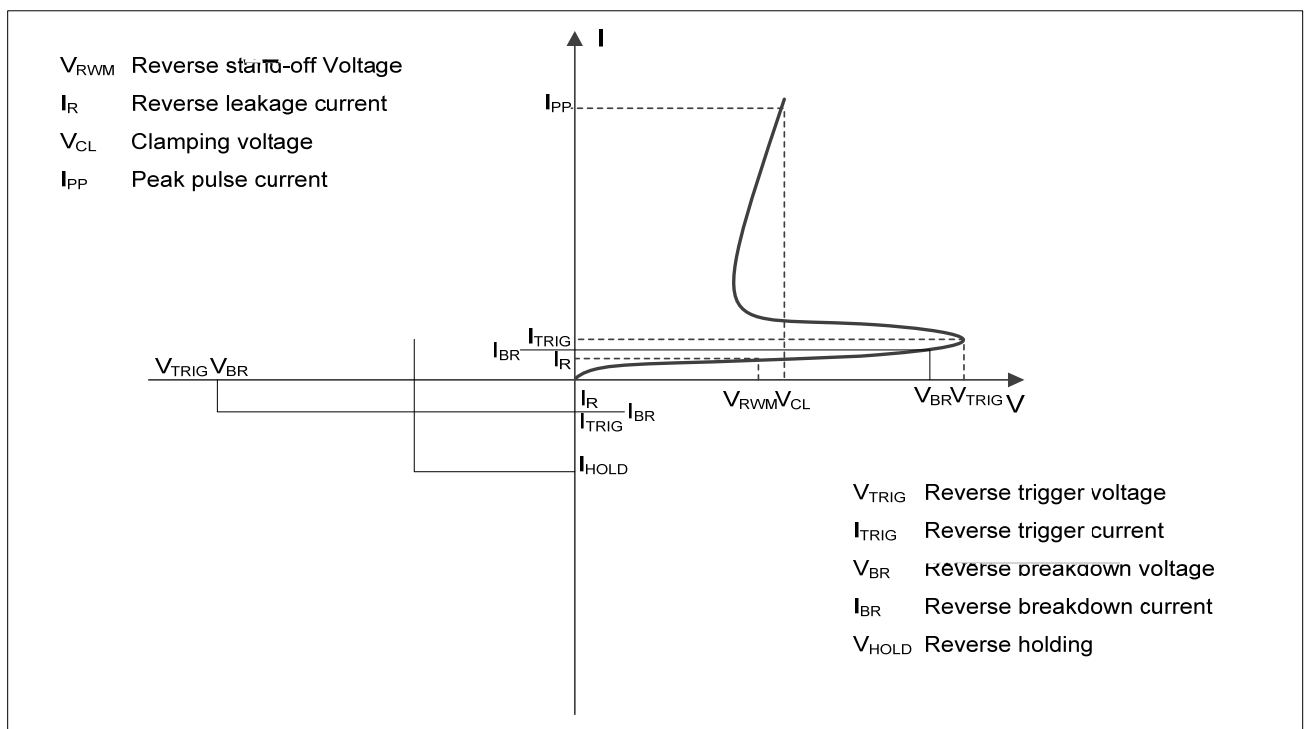


V

8/20 μ s waveform per IEC61000 # 5

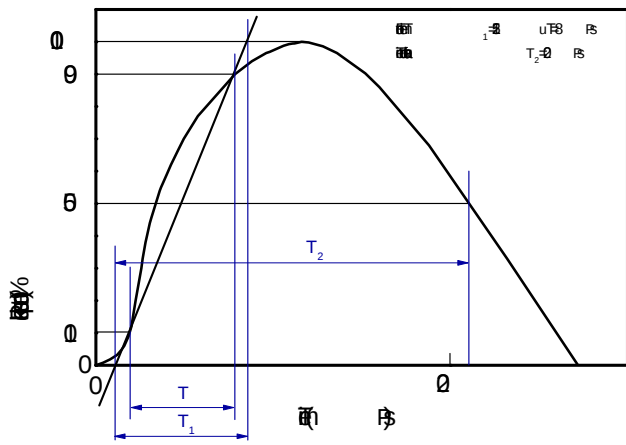

Clamping voltage vs. Peak pulse current

Contact discharge current waveform per IEC61000 # 2

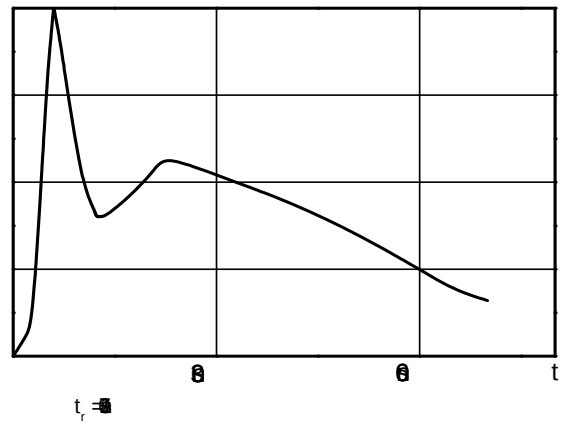

Capacitance vs. Reverse voltage

Non repetitive peak pulse power vs. Pulse time

Power derating vs. Ambient temperature




ESD clamping
(+8kV contact discharge per IEC61000 # 2)

ESD clamping
(8kV contact discharge per IEC61000 # 2)


TLP Measurement

V



6 \ P E R O P L Q P P 0 D [P P

V

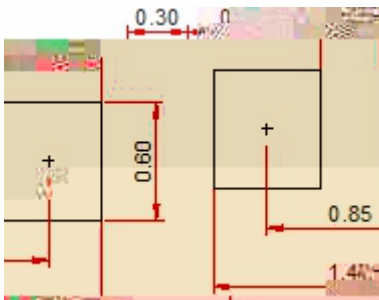

61
881669



11/11/11
11/11/11
11/11/11

11/11/11

11/11/11
11/11/11

11/11/11

11/11/11

11/11/11

11/11/11

11/11/11

11/11/11